



↑  
↑  
↑  
↑  
↑  
Air inlet

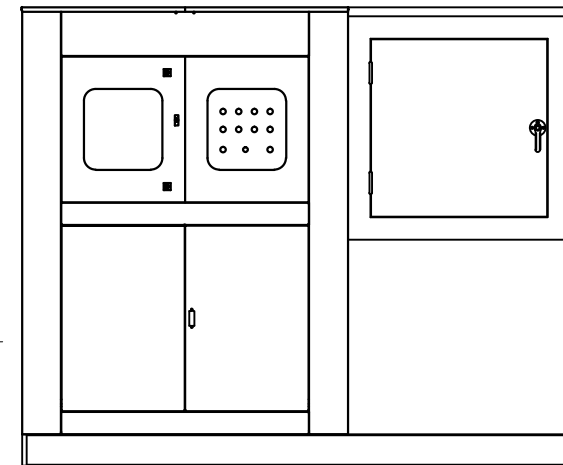

H direction

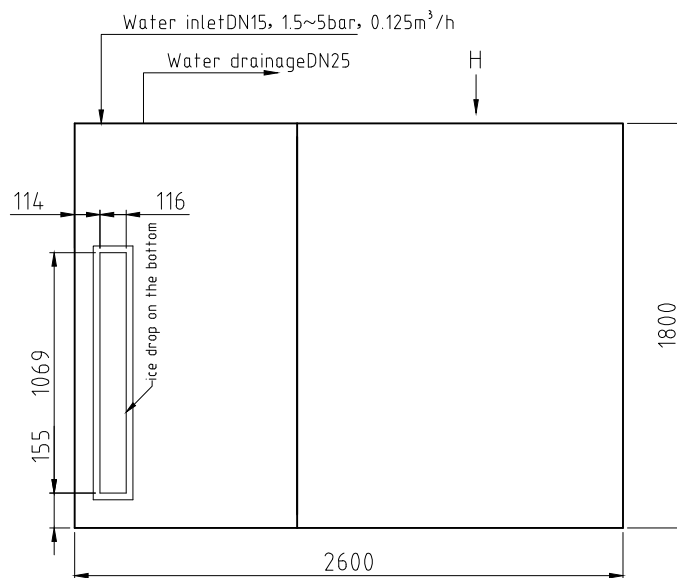

Remarks:

1. there should be at least 1m space around the unit and at least 0.6m space on the top of the unit for service,;
2. The dimensions are for reference only, the specific is subject to the actual object;
3. the client provides water source to meet 1.5~5bar water flow rate and pressure;
4. the water pipe lines and cables should be connected to the appointed interfaces of our equipments;
5. the supply scope is subject to the Sales Contract.

Technical Data;

|                        |                |
|------------------------|----------------|
| Water inlet temp.      | 25°C           |
| Ambient temp.          | 35°C           |
| Condensing temp.       | 45°C           |
| Refrigeration capacity | 21.2kW         |
| Production capacity    | 3t/24hr        |
| Power supply           | 380V/50Hz/3P   |
| Refrigerant            | R404A          |
| Installation power     | Approx.21.75kW |
| Water consumption      | 0.125t/hr      |
| Dimension              | 2440×1800×2040 |
| Unit net weight        | Approx.1.8t    |
| Unit running weight    | Approx.2.5t    |

| Itemref     | Quantity   | Title/Name, designation, material, dimension etc | Article No./Reference           |      |         |
|-------------|------------|--|---------------------------------|------|---------|
| Designed by | Checked by | Approved by - date                               | Filename                        | Date | Scale   |
|             |            |  | 3T/day plate ice machine layout |      |         |
|             |            |  | PIM30AF                         |      | Edition |